


AQUAFAN : AF-2/75

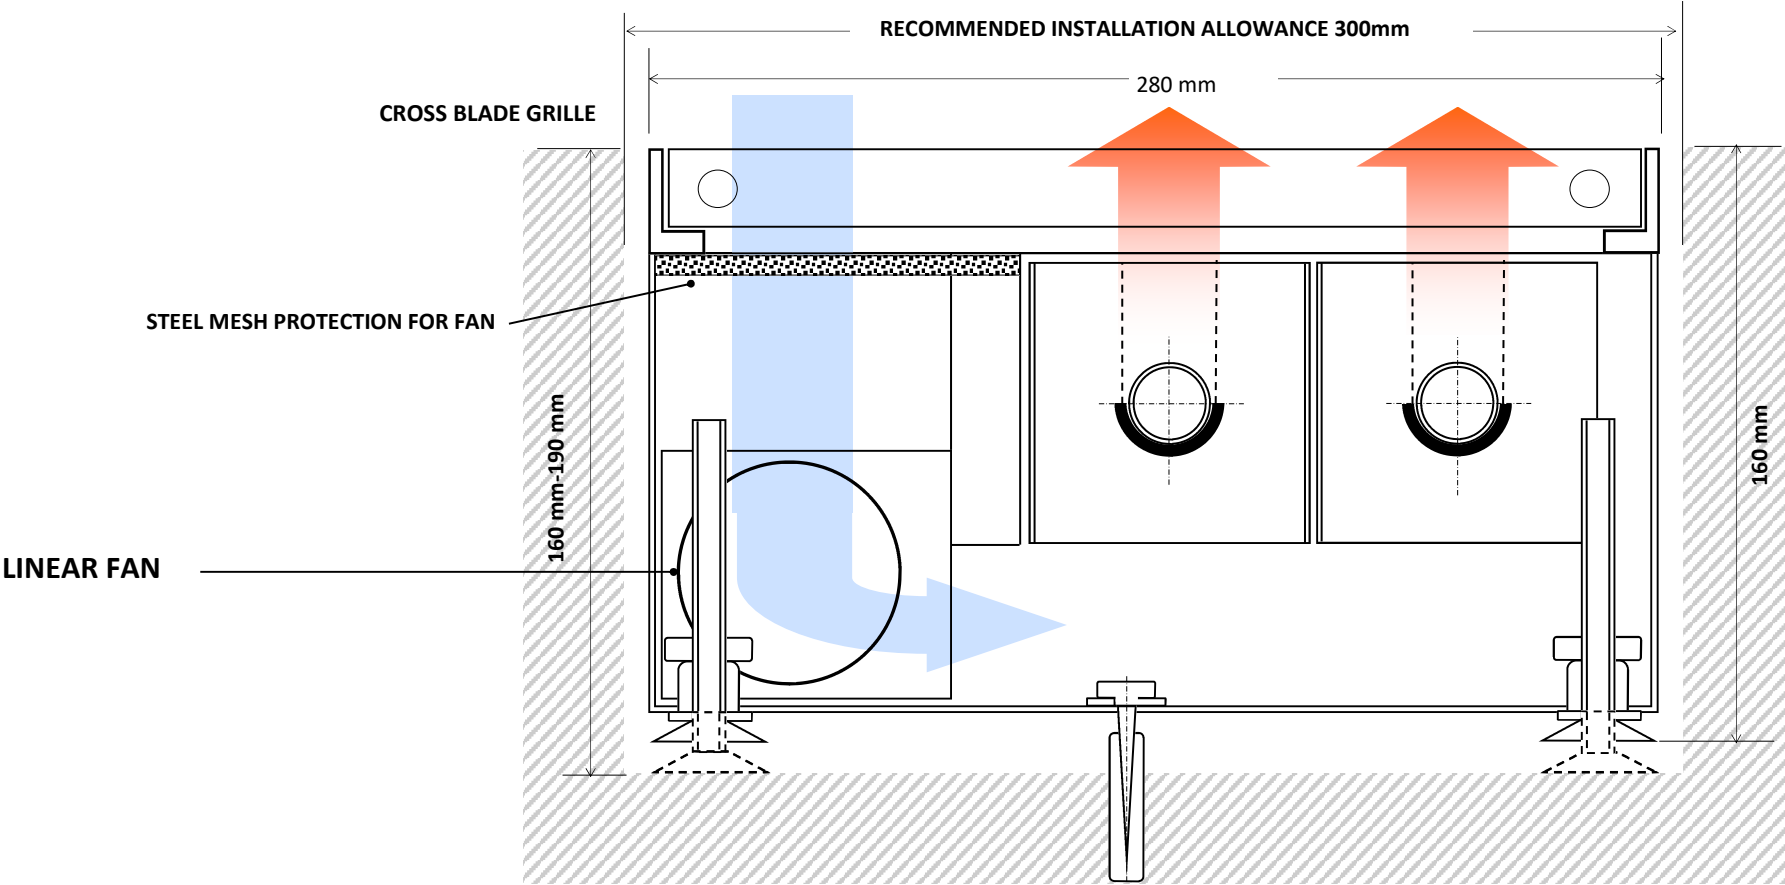

SPECIFICATION

- FLEXIBLE HOSE CONNECTORS
- SIEMENS CONTROLLER
- 230 V SUPPLY
- 24 V DC FAN MOTOR
- SAFETY CUT OUTS
- WALL MOUNTED CONTROL
- TEMPERATURE CONTROLLED
- MANUAL OVERRIDE

CROSS SECTION

Calculation for ΔT = mean water temperature less entering air temperature. Example: ΔT = 82 + 72 - 20 = 57 Deg C

2


PROJECT REFERENCE	
GRILLE	Natural Satin Anodised Aluminium
ANGLE	Natural Satin Anodised Aluminium
FINNED ELEMENT BANK	2 Qty: 75 mm x 75 mm
PIPE	22 mm Ø COPPER
TRENCH: WIDTH x HEIGHT	280 mm x 160 mm

PERCENTAGE OF FAN CAPACITY	OUTPUT AT 20ΔT (WATTS)	OUTPUT AT 30ΔT (WATTS)	OUTPUT AT 40ΔT (WATTS)	OUTPUT AT 50ΔT (WATTS)	OUTPUT AT 60ΔT (WATTS)	OUTPUT AT 70ΔT (WATTS)
HIGH	834	1264	1699	2137	2576	3018
MEDIUM	643	978	1317	1659	2004	2351
LOW	465	713	965	1221	1480	1741




DUCT ENGINEERING (LUTON) LTD
Unit E, Cradock Road Ind Est, Luton,
Bedfordshire, LU4 0JF.
Phone: 0044 (0) 1525 562626
Email: sales@ductengineering.co.uk

AQUAFAN: AF-2/75

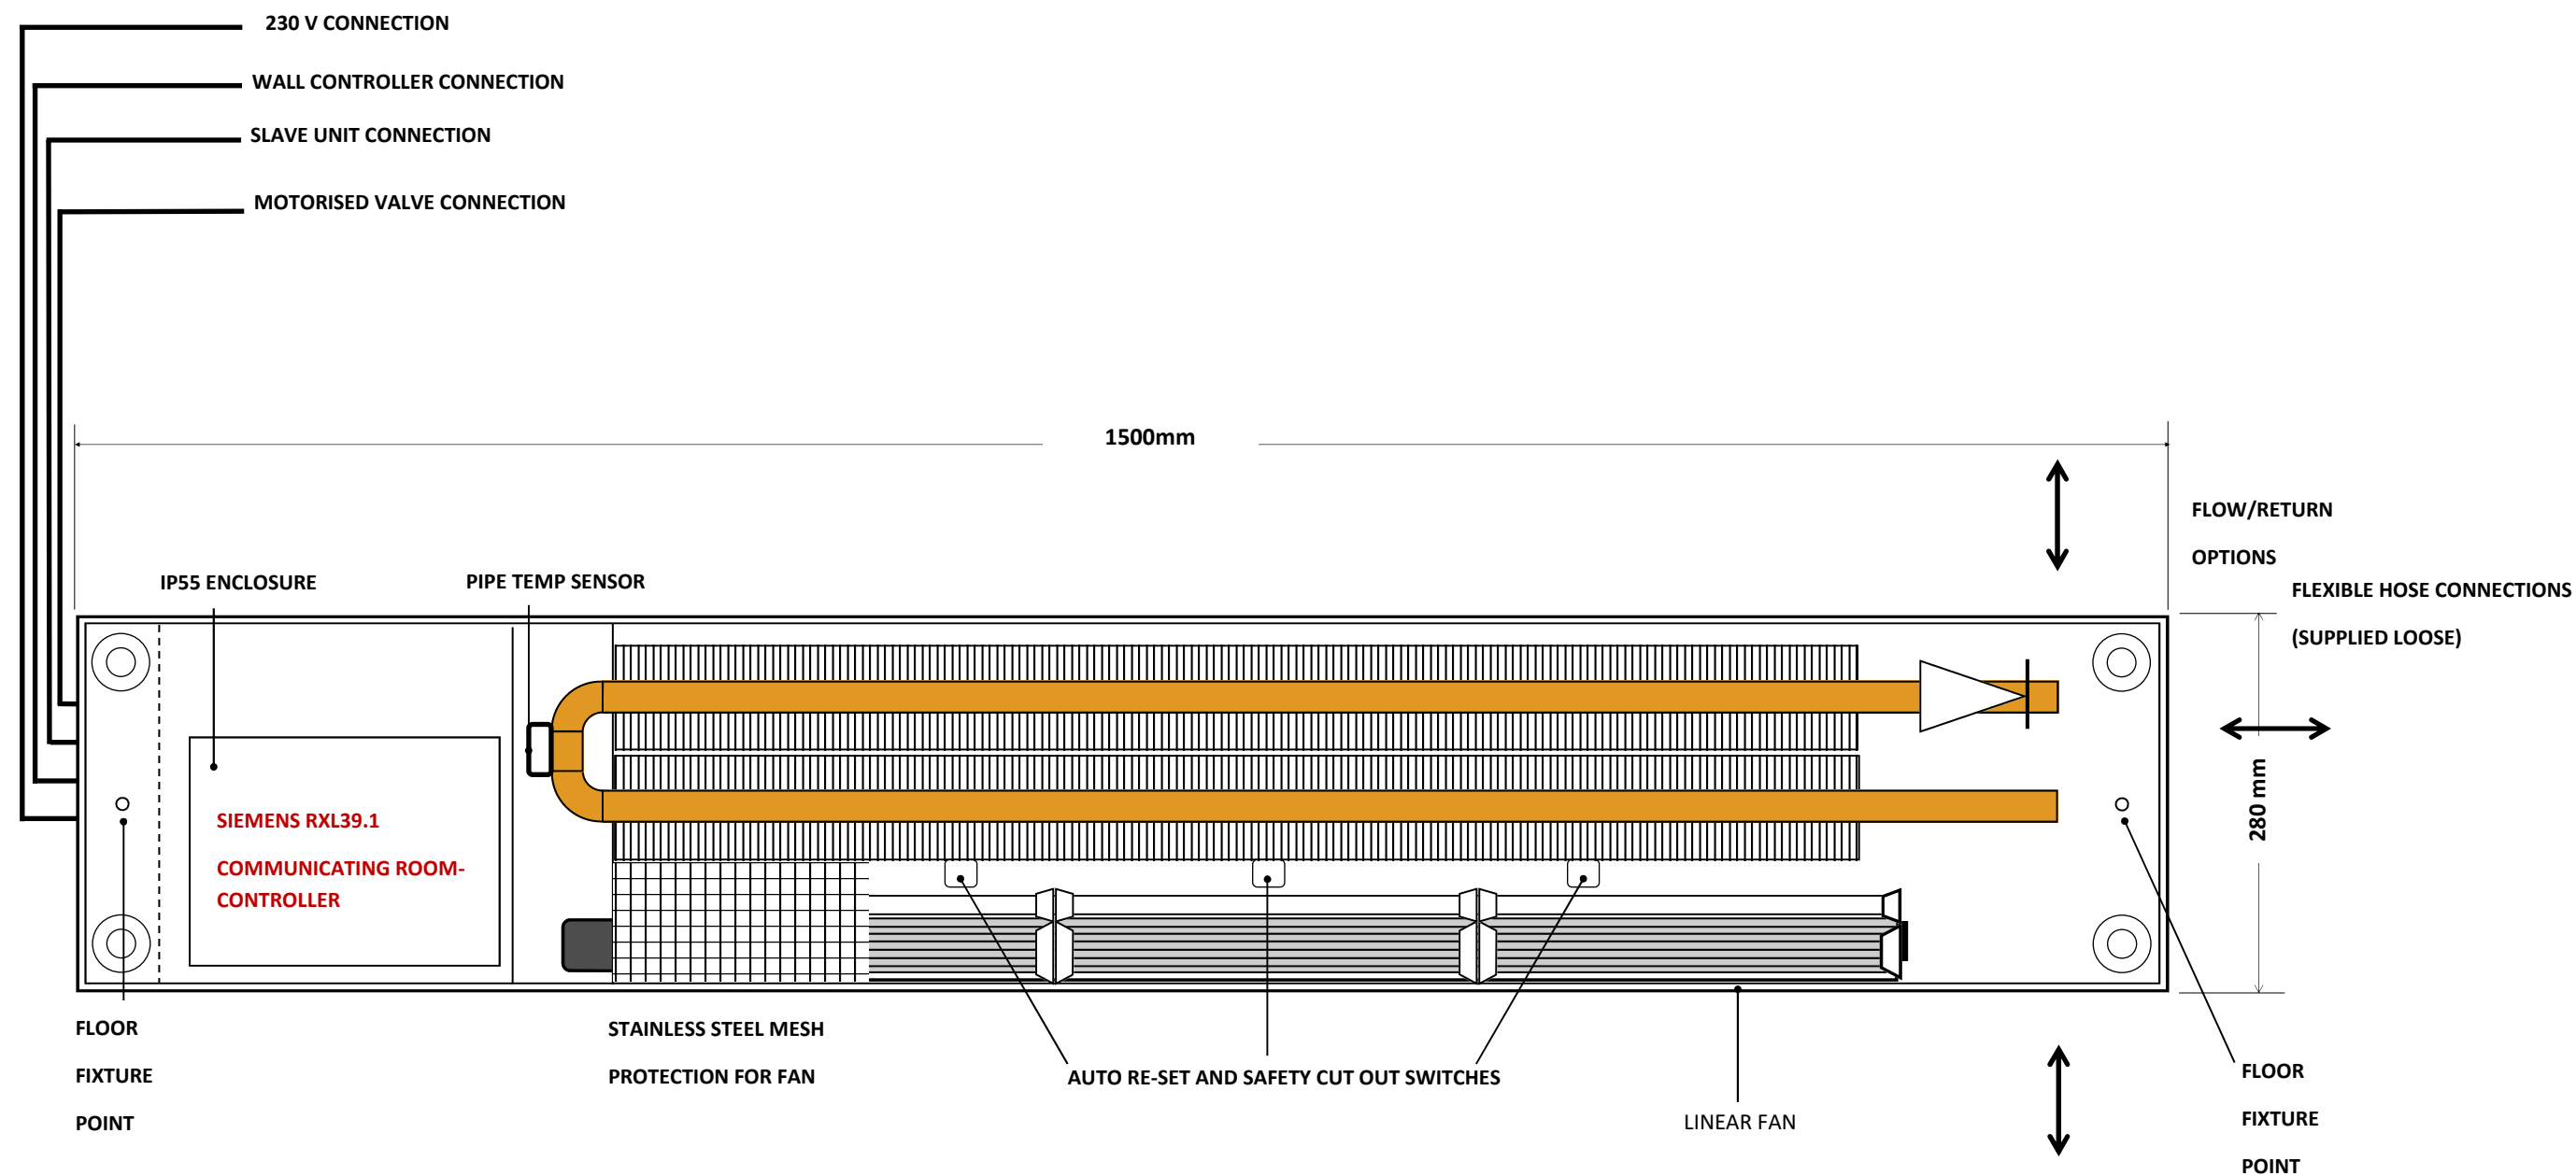


MASTER CONTROL UNIT



DUCT ENGINEERING (LUTON) LTD
Unit E, Cradock Road Ind Est, Luton,
Bedfordshire, LU4 0JF.
Phone: 0044 (0) 1525 562626
Email: sales@ductengineering.co.uk

AQUAFAN: AF-2/75

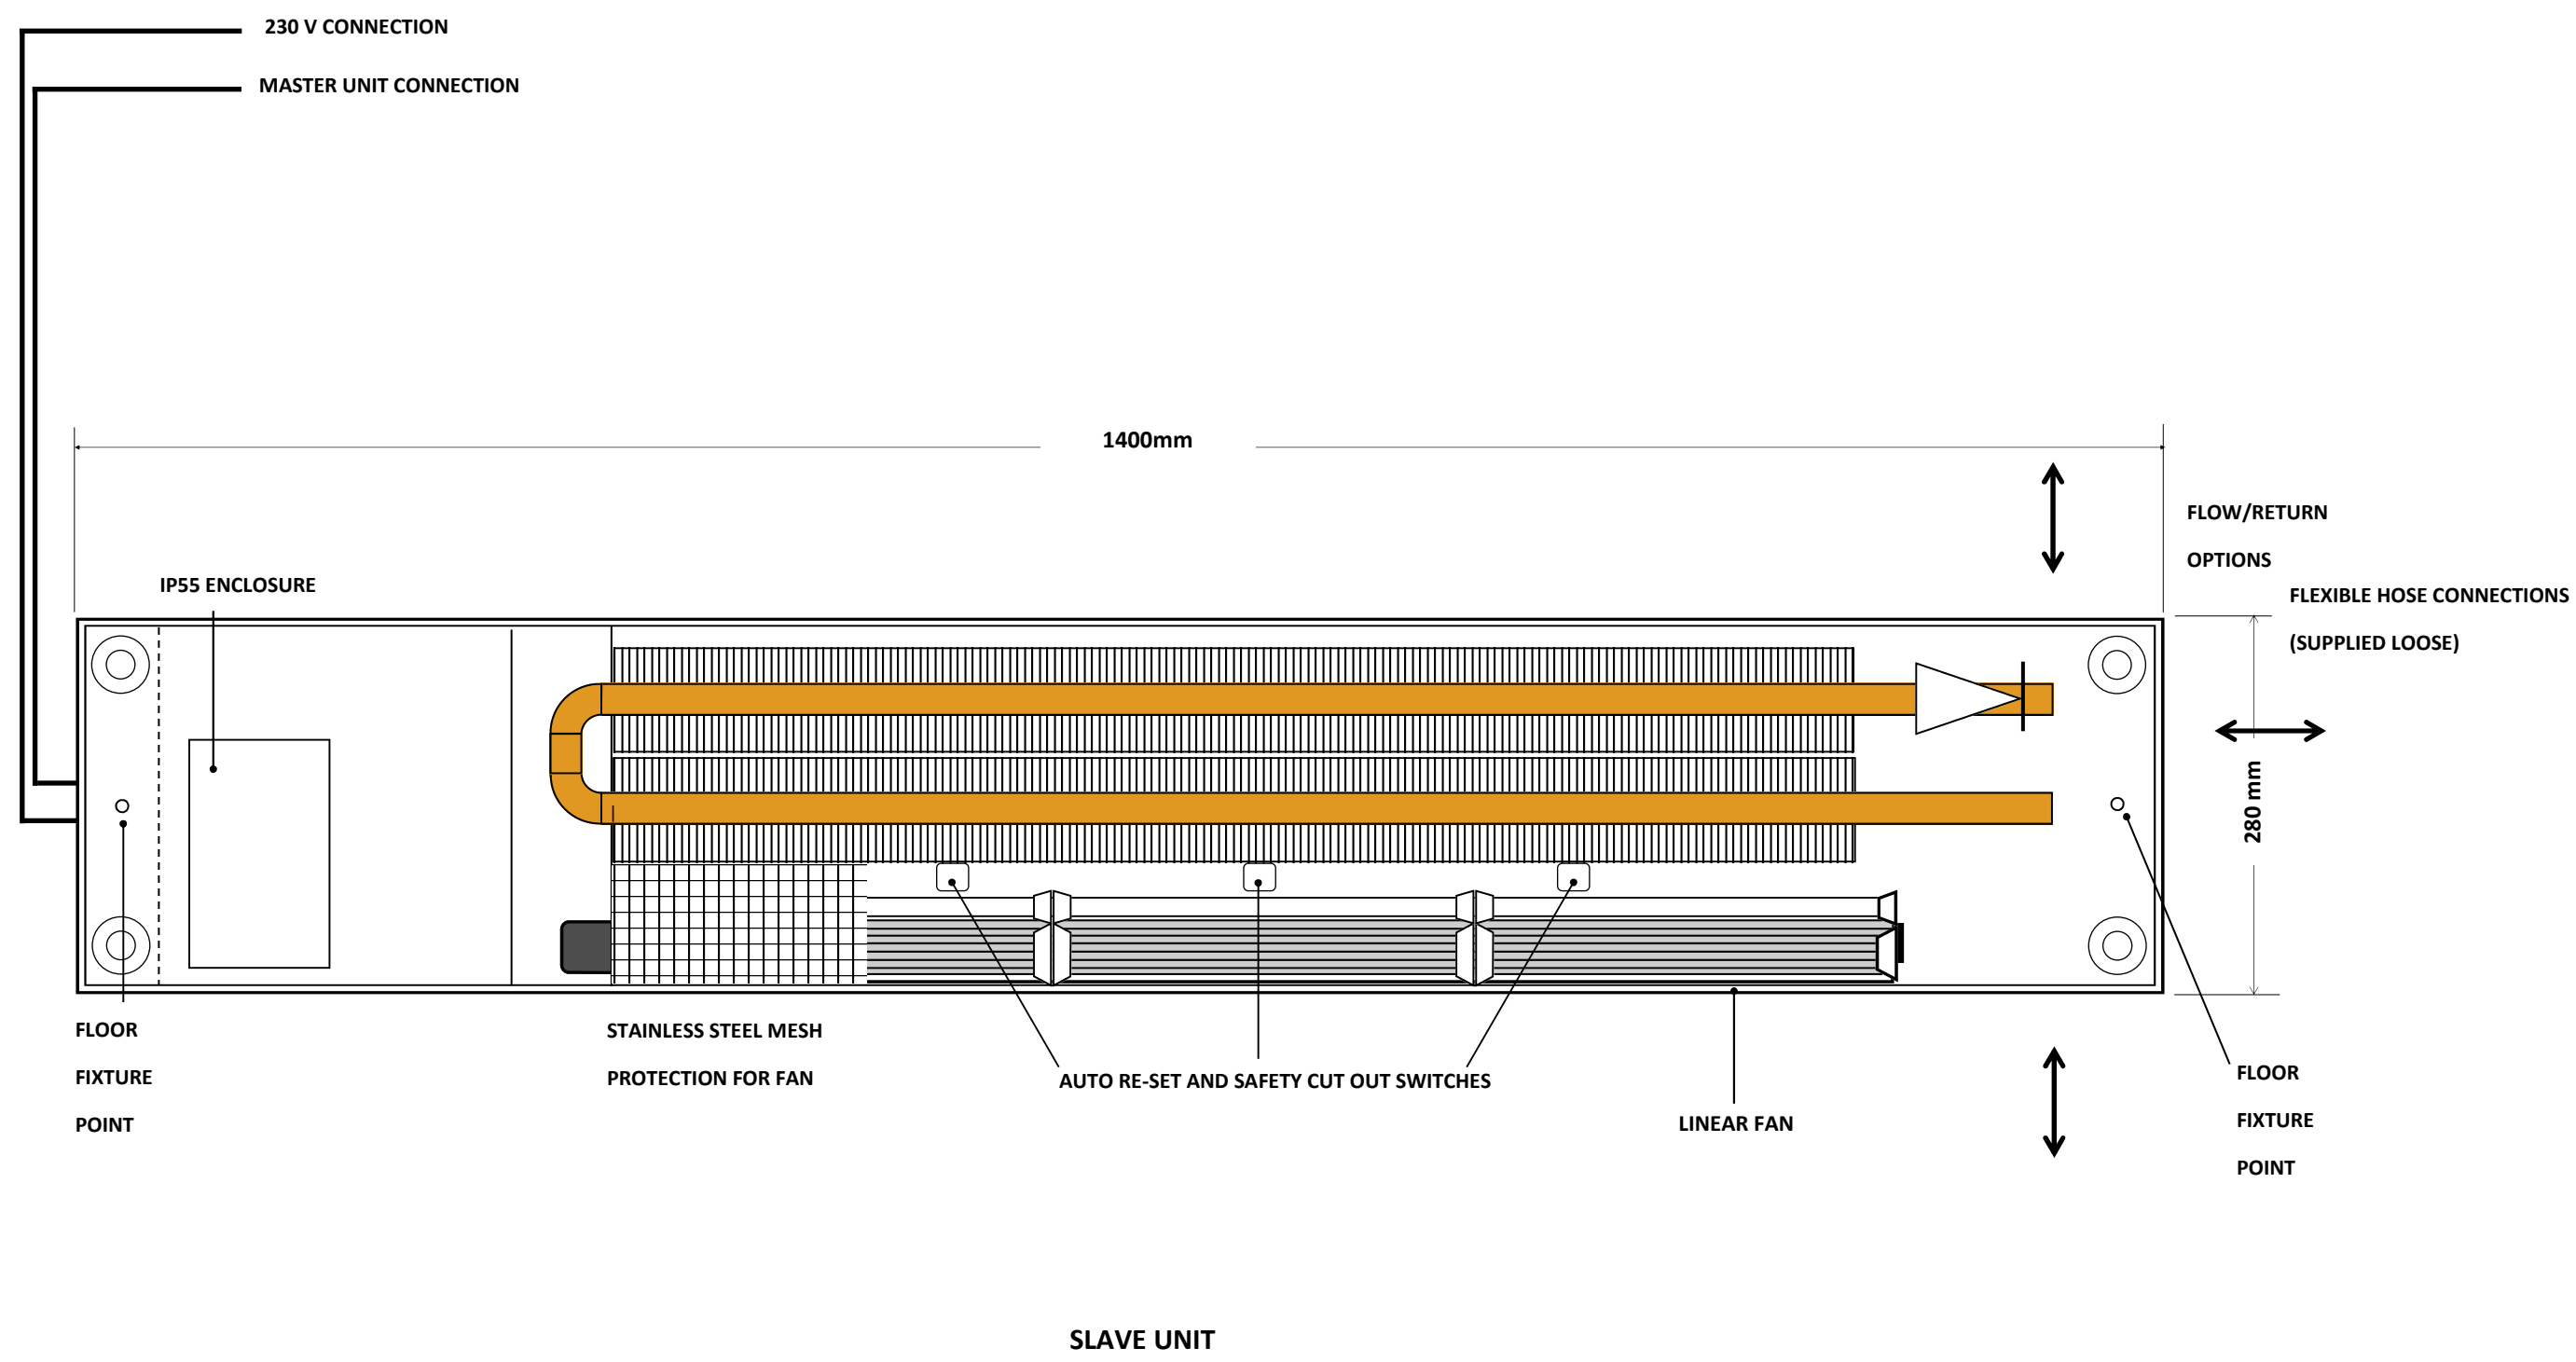

DUCT ENGINEERING (LUTON) LTD
Unit E, Cradock Road Ind Est, Luton,
Bedfordshire, LU4 0JF.
Phone: 0044 (0) 1525 562626
Email: sales@ductengineering.co.uk