


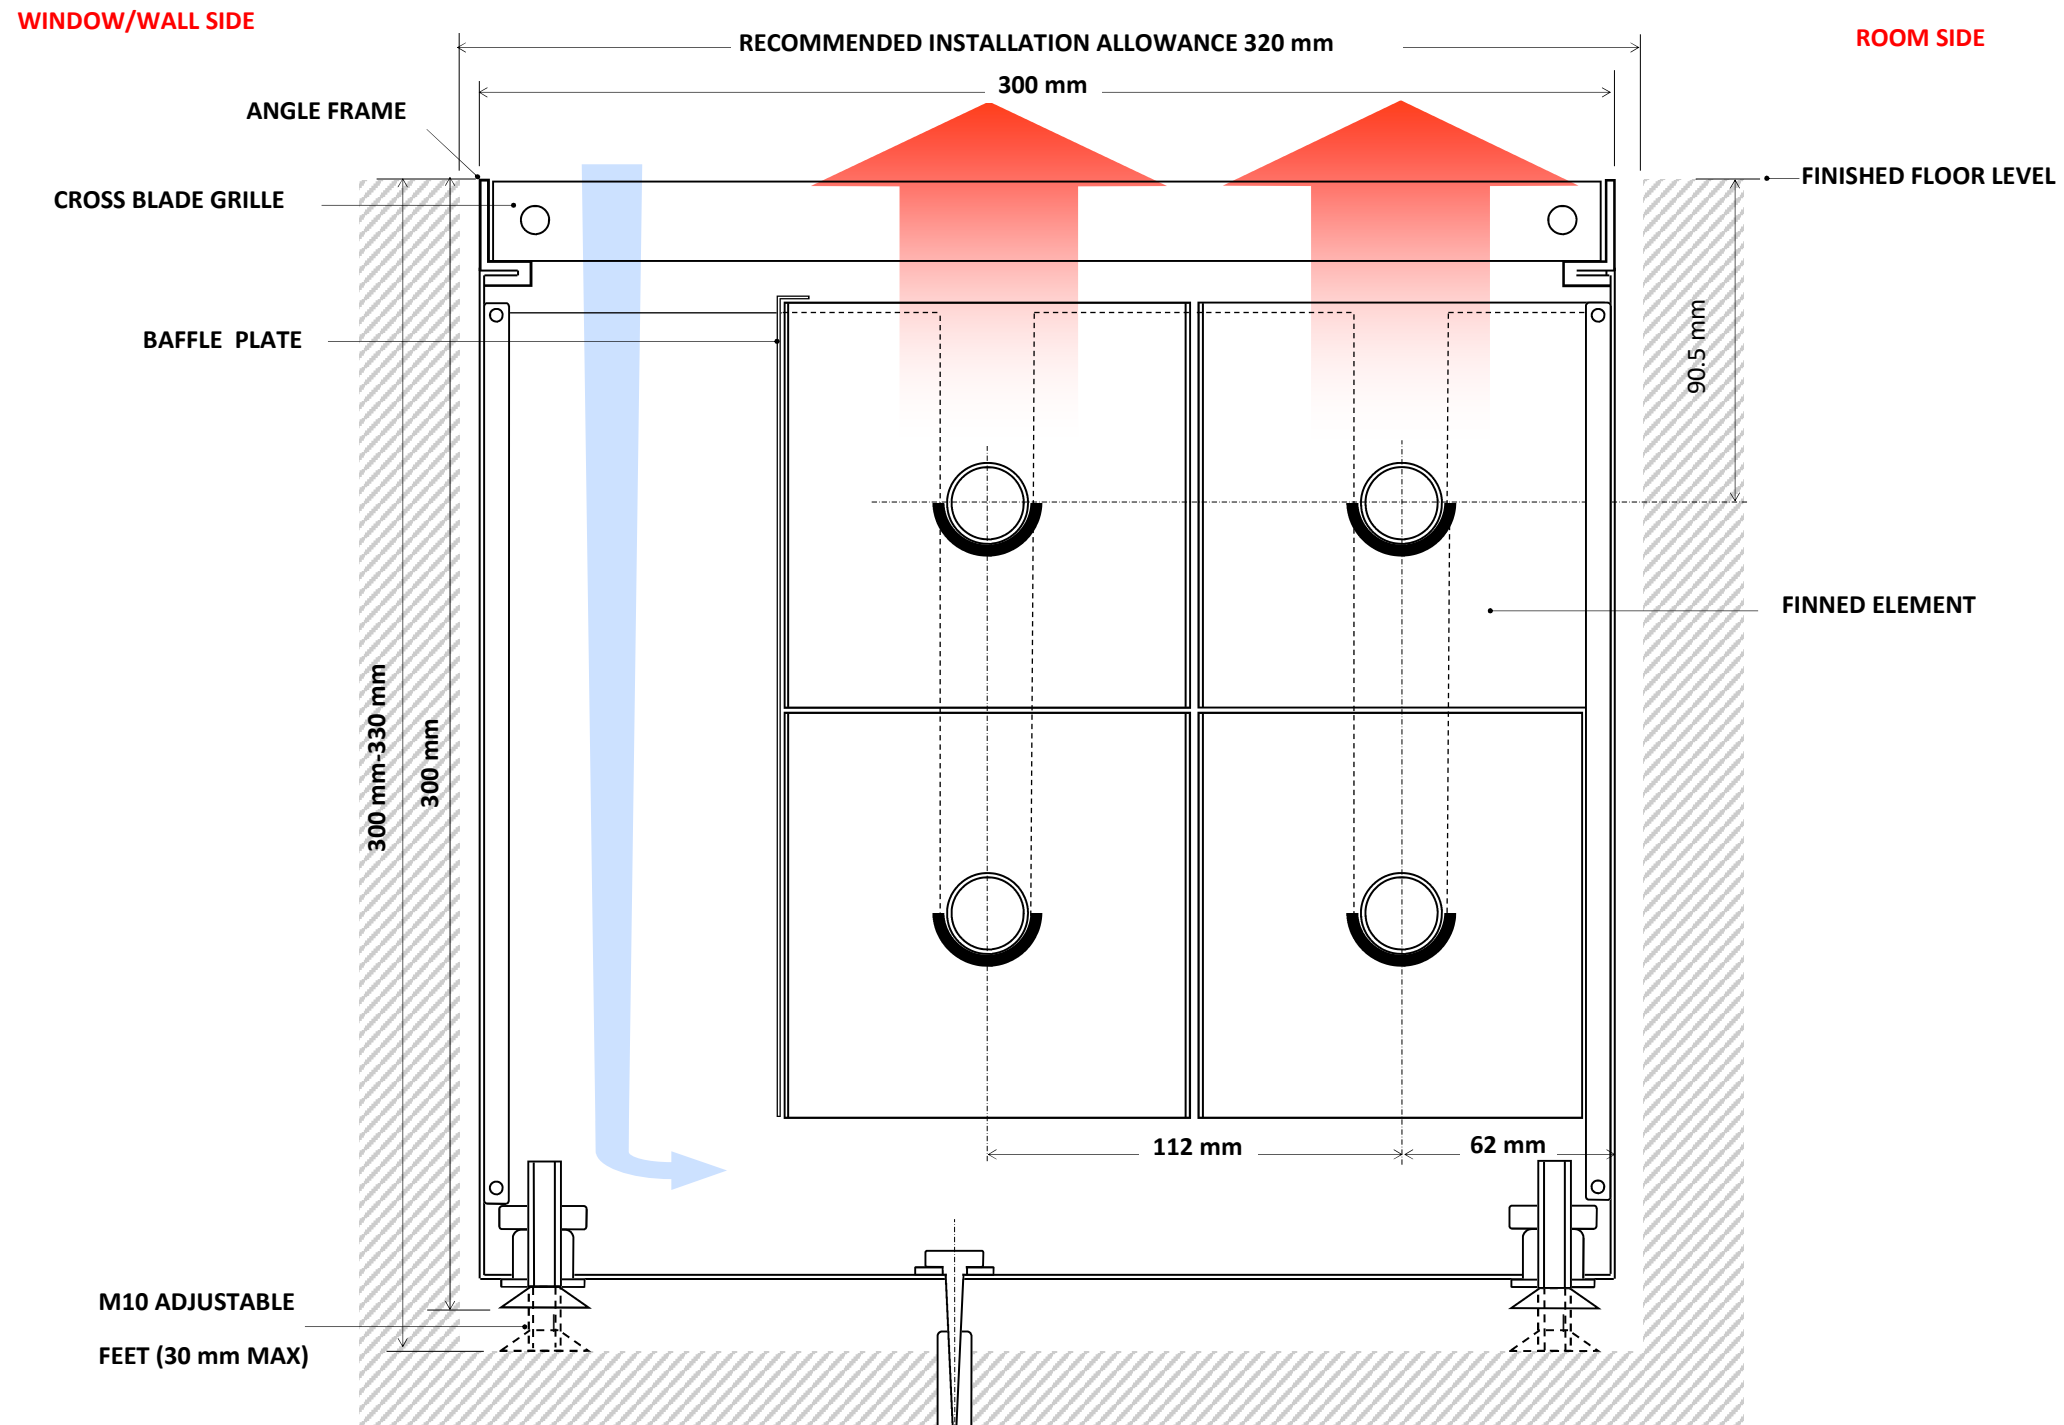

TYPE: T14.O: 300 mm Wide x 300mm High

Finned Element: 4 Qty. 108 mm x 108 mm 22 mm Ø pipe

Heat out put is calculated by the following formula:


Water Flow temperature °C + Return °C ÷ 2 minus Air in temperature = Watts Output per metre of active finned element.

Example: 80°C Flow + 60°C Return temperature = 140°C ÷ 2 = 70°C less air temperature 20°C = 50°C ΔT

Watts at 30°CΔT	Watts at 40°CΔT	Watts at 50°CΔT	Watts at 60°CΔT
258	405	593	844

*** Please note our units are tested to DIN EN 16430, test data available on request.**

FINNED ELEMENT BANK LAYOUT

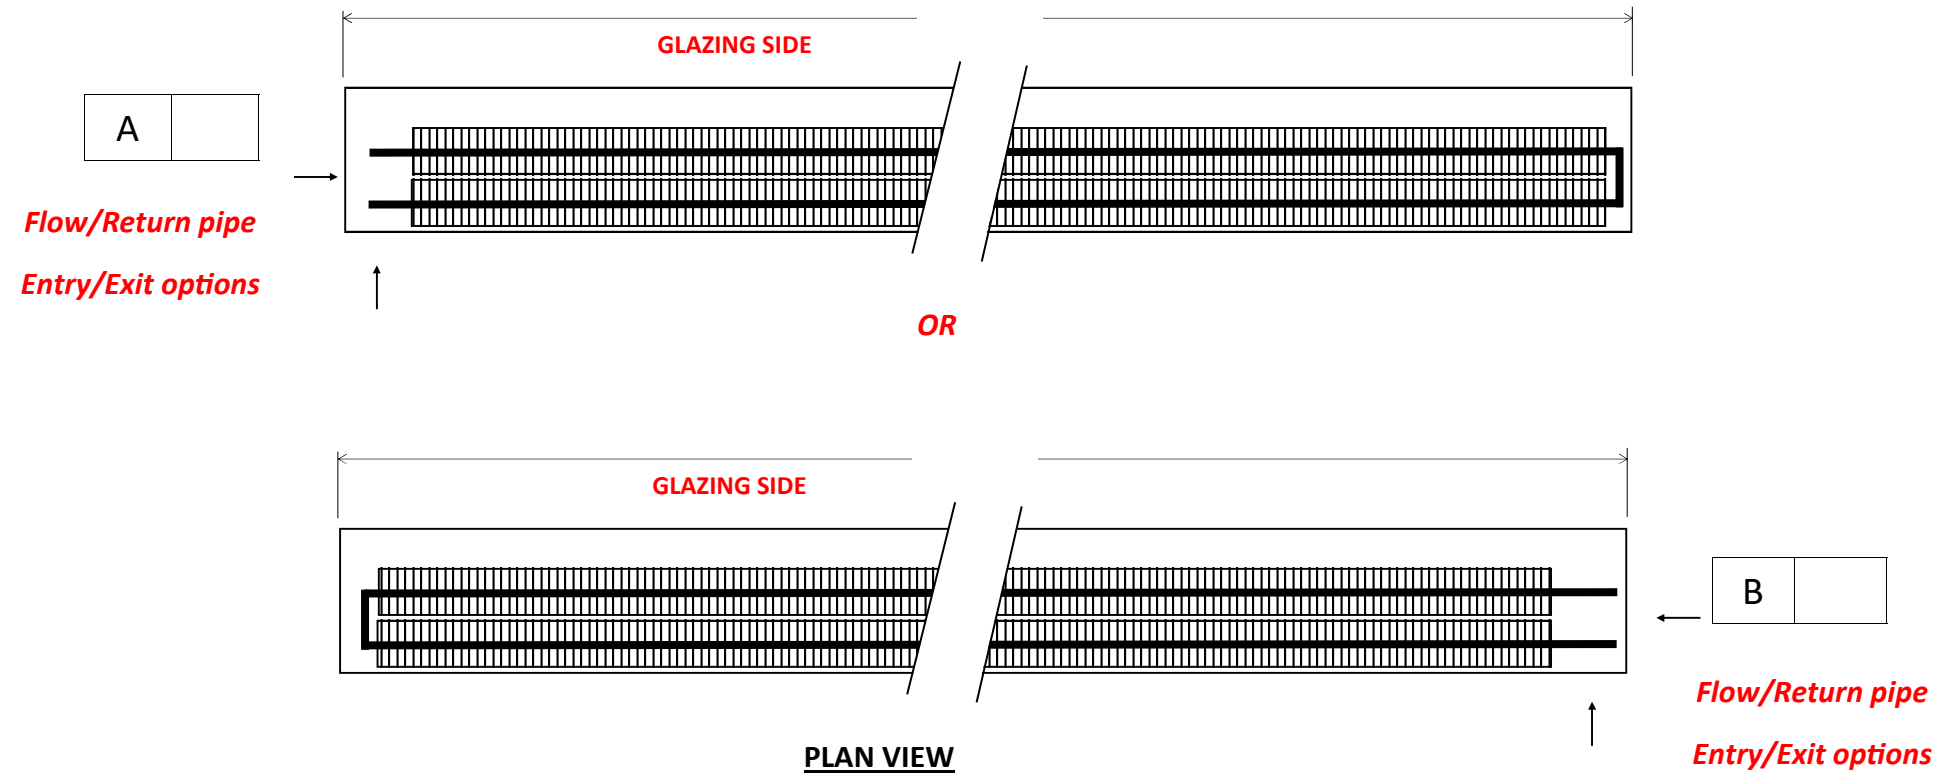

AIR VENTS ARE SUPPLIED LOOSE. ANY OTHER VALVES,CONTROLS TO BE

PROJECT REFERENCE	
GRILLE	Natural Satin Anodised Aluminium
ANGLE	Natural Satin Anodised Aluminium
FINNED ELEMENT BANK	4 Qty: 108 mm x 108 mm
PIPE	22 mm Ø COPPER
TRENCH: WIDTH x HEIGHT	300 mm x 300 mm

Delivery address:

House No/Name:.....

Road:.....


Town/City:

Post Code:.....

Drawing Approval. Please tick Option A or B

Signature:.....

Date:.....



DUCT ENGINEERING (LUTON) LTD

Unit E, Cradock Road Ind Est, Luton,

Bedfordshire, LU4 0JF.

Phone: 0044 (0) 1525 562626

Email: sales@ductengineering.co.uk