


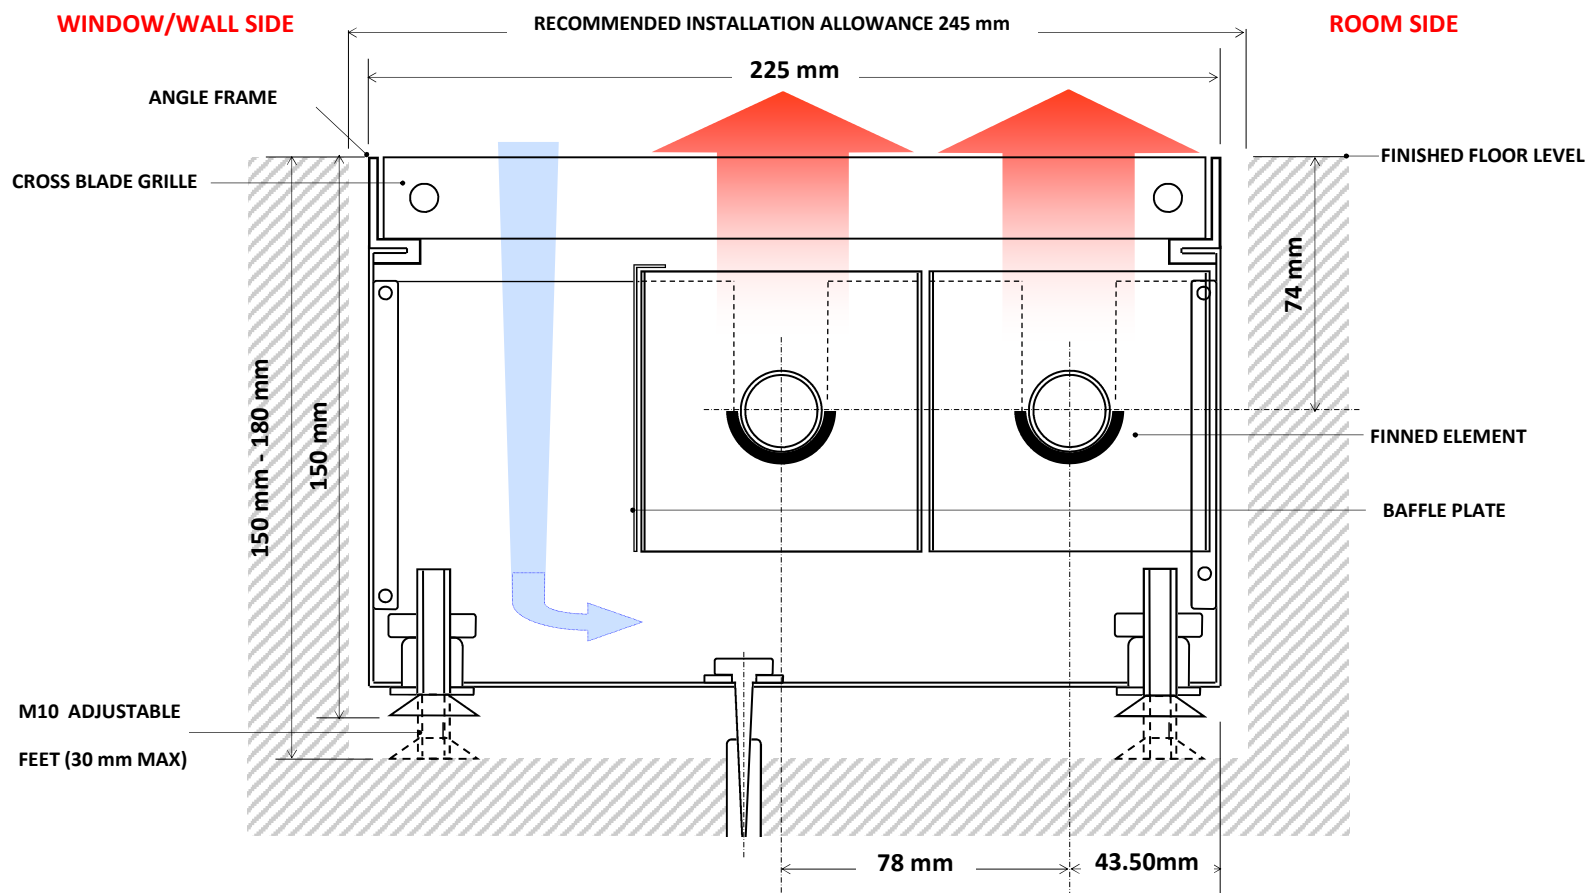

TYPE: T6.O: 225 mm Wide x 150 mm High

Finned Element: 2 Qty. 75mm x 75mm on 22 mm Ø pipe

Heat out put is calculated by the following formula:


Water Flow temperature °C + Return °C ÷ 2 minus Air in temperature = Watts Output per metre of active finned element.

Example: 80°C Flow + 60°C Return temperature = 140°C ÷ 2 = 70°C less air temperature 20°C = 50°C ΔT

Watts at 30°CΔT	Watts at 40°CΔT	Watts at 50°CΔT	Watts at 60°CΔT
140	215	320	400


* Please note our units are tested to DIN EN 16430, test data available on request.

FINNED ELEMENT BANK LAYOUT

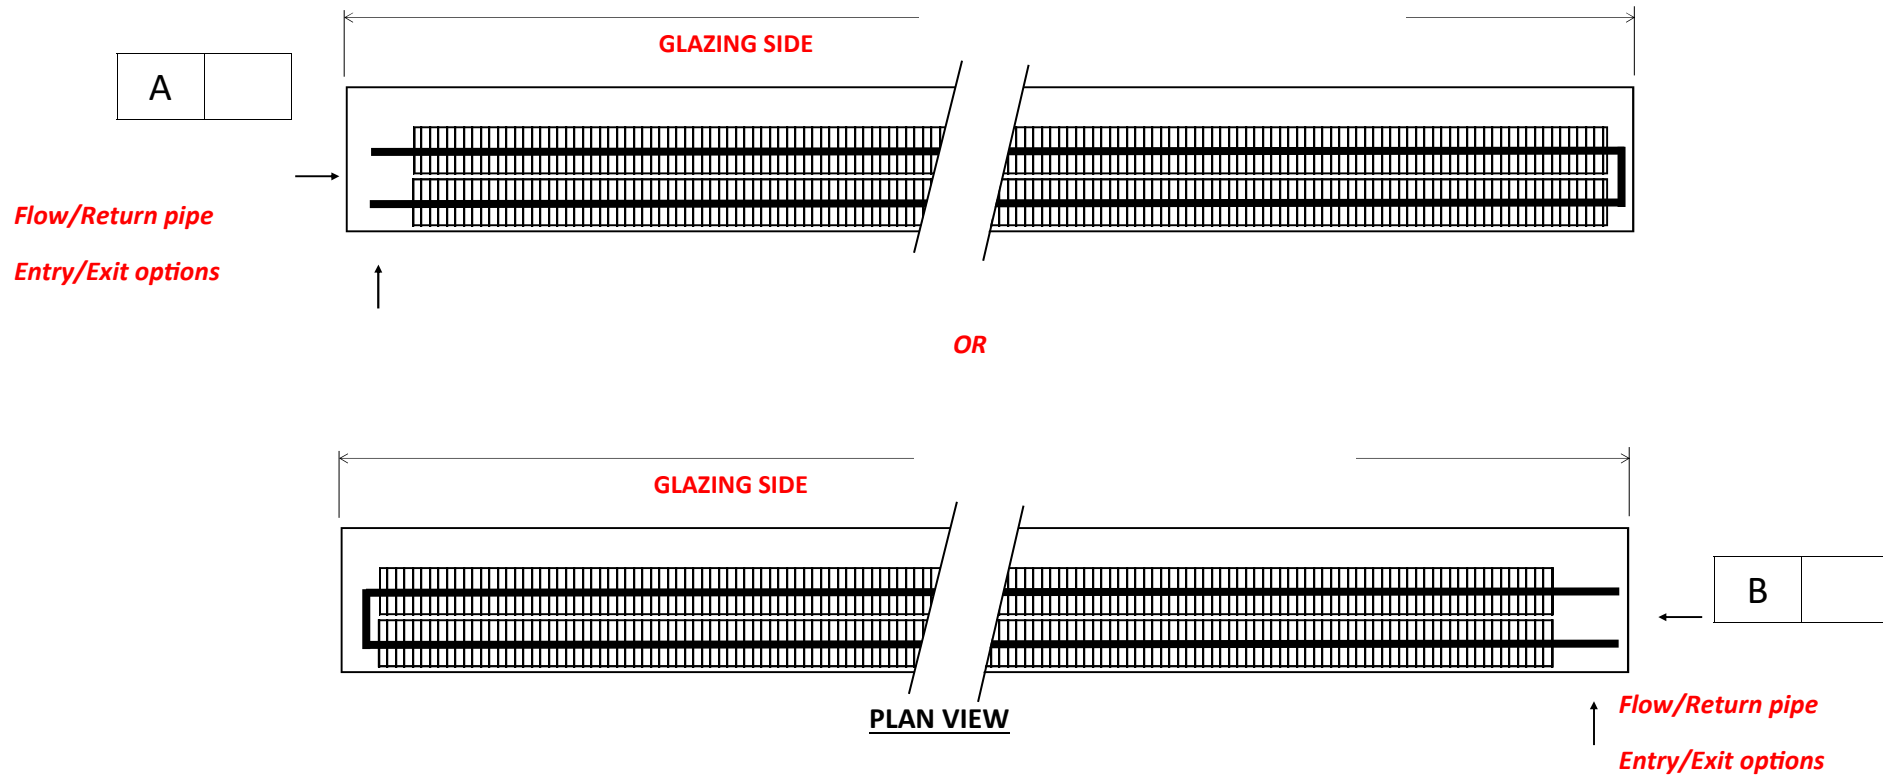

AIR VENTS ARE SUPPLIED LOOSE. ANY OTHER VALVES, CONTROLS TO BE SUPPLIED BY INSTALLER

PROJECT REFERENCE	
GRILLE	Natural Satin Anodised Aluminium
ANGLE	Natural Satin Anodised Aluminium
FINNED ELEMENT BANK	2 Qty: 75 mm x 75 mm
PIPE	22 mm Ø COPPER
TRENCH WIDTH x HEIGHT	225 mm x 150 mm



DUCT ENGINEERING (LUTON) LTD

Unit E, Cradock Road Ind Est, Luton,

Bedfordshire, LU4 0JF.

Phone: 0044 (0) 1525 562626

Email: sales@ductengineering.co.uk