


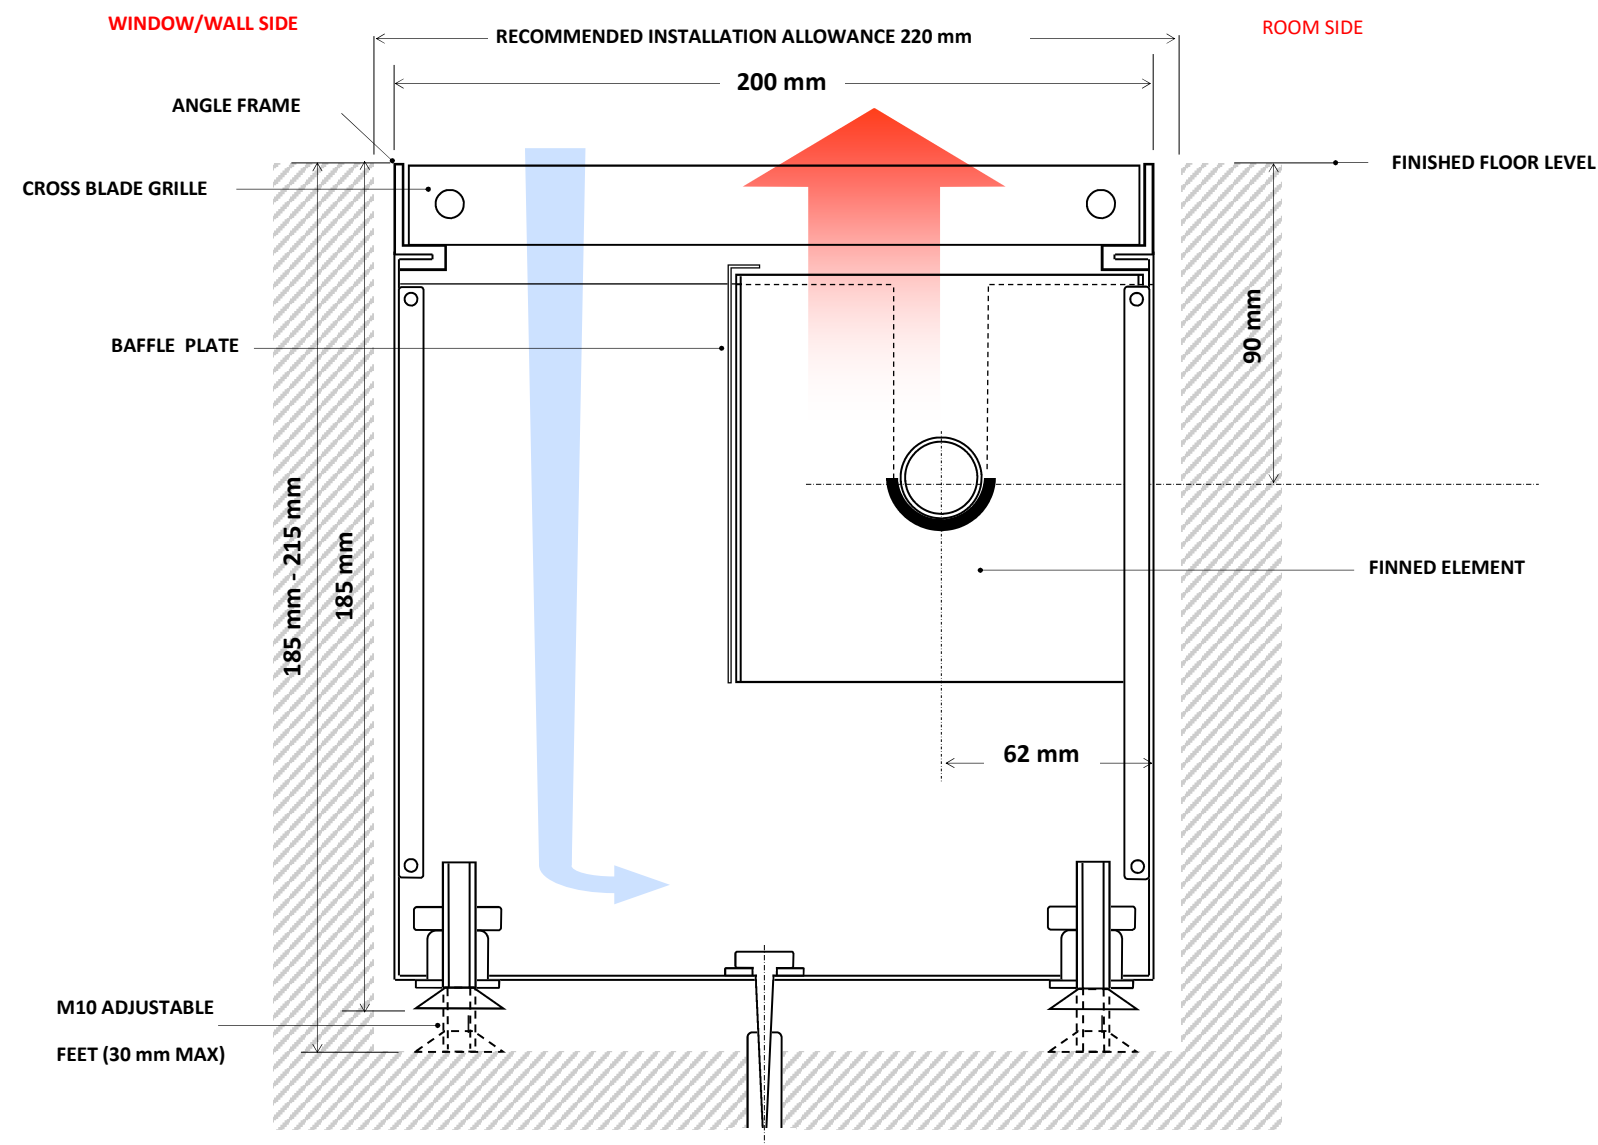

TYPE: T9.O: 200 mm Wide x 185 mm High

Finned Element: 1 Qty. 108mm x 108mm on 22 mm Ø pipe

Heat out put is calculated by the following formula:

Water Flow temperature °C + Return °C ÷ 2 minus Air in temperature = Watts Output per metre of active finned element.


Example: 80°C Flow + 60°C Return temperature = 140°C ÷ 2 = 70°C less air temperature 20°C = 50°C ΔT

Watts at 30°CΔT	Watts at 40°CΔT	Watts at 50°CΔT	Watts at 60°CΔT
120	189	244	304

* Please note our units are tested to DIN EN 16430, test data available on request.

FINNED ELEMENT BANK LAYOUT

GLAZING SIDE

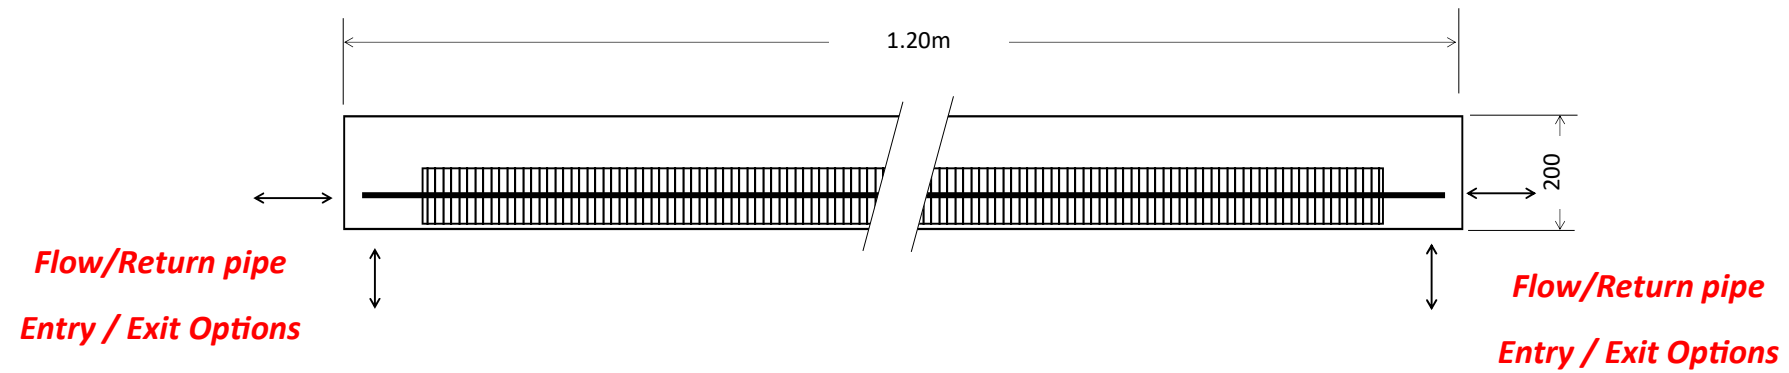

PLAN VIEW

AIR VENTS ARE SUPPLIED LOOSE. ANY OTHER VALVES,CONTROLS TO BE SUPPLIED BY INSTALLER

PROJECT REFERENCE	
GRILLE	Natural Satin Anodised Aluminium
ANGLE	Natural Satin Anodised Aluminium
FINNED ELEMENT BANK	1 Qty: 108 mm x 108 mm
PIPE	22 mm Ø COPPER
TRENCH: WIDTH x HEIGHT	200 mm x 185 mm

Delivery address:

House No/Name:.....

Road:.....

Town/City:

Post Code:.....

Drawing Approval

Signature:.....

Date:.....



DUCT ENGINEERING (LUTON) LTD

Unit E, Cradock Road Ind Est, Luton,

Bedfordshire, LU4 0JF.

Phone: 0044 (0) 1525 562626

Email: sales@ductengineering.co.uk